

CAT5e Cable  
Recommended for less than 100m length and low Electrical noise areas

Riser




Ethernet Switch

BMS Computer

CAT5e Cable

Note: CAT5e and power cables to be routed separately

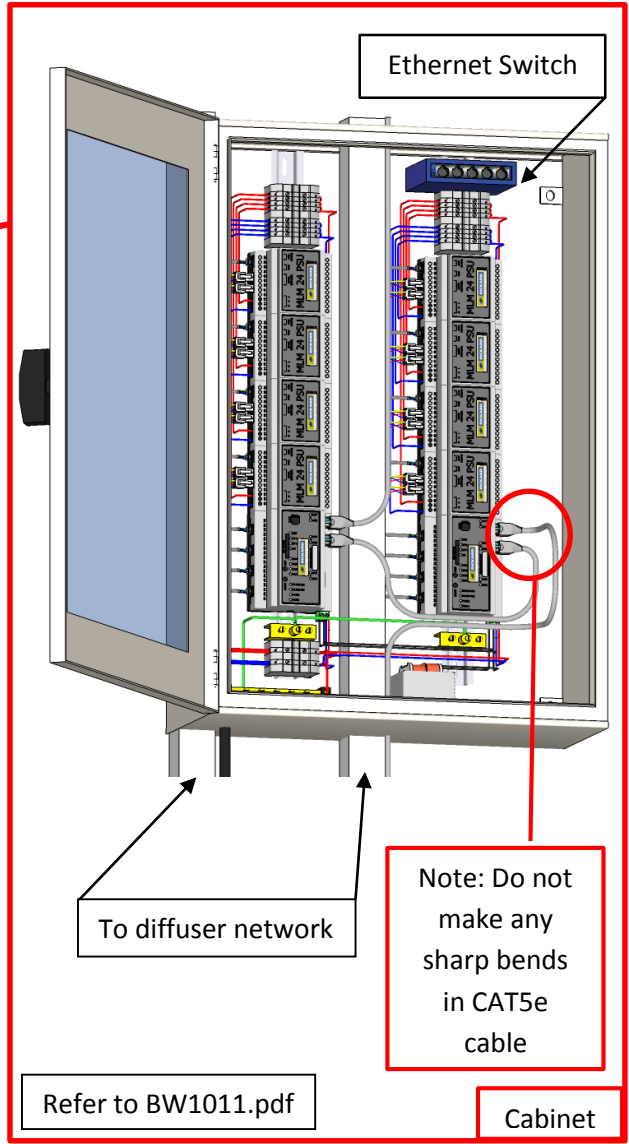

Ethernet Switch

To diffuser network

Refer to BW1011.pdf

Note: Do not make any sharp bends in CAT5e cable

Cabinet

**RICKARD**  
INTELLIGENT COMFORT CONTROL  
16 Harris Drive  
Ottery, Cape Town  
South Africa, 7808  
+27 (21) 704 1533

Changes at this issue					
Magnetic Ethernet Simple Topology					
Approved	Checked	Drawn	PROTO	ISS	Date
		PP	ECP	a	27/05/2011
<b>TITLE: MLM24 Ethernet Backbone</b>					
DOC: BW0011-b			SHEET 1 OF 1		
FILENAME: BW0011-b.docx					